

Location and Resource

Module

Inverter




System Design

Shading and Layout

Losses

Grid Limits

Metric	Value
Annual AC energy in Year 1	1451,826 kWh
DC capacity factor in Year 1	10.2%
Energy yield in Year 1	886 kWh/kW
Performance ratio in Year 1	0.90

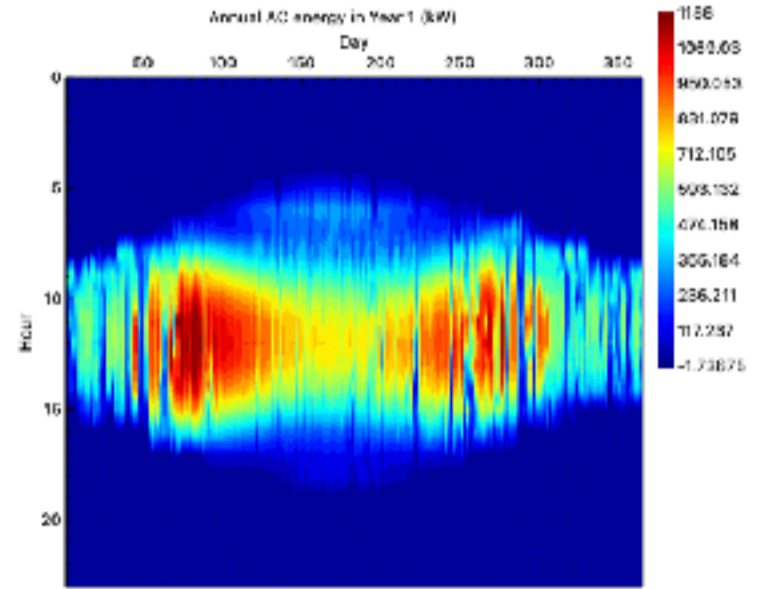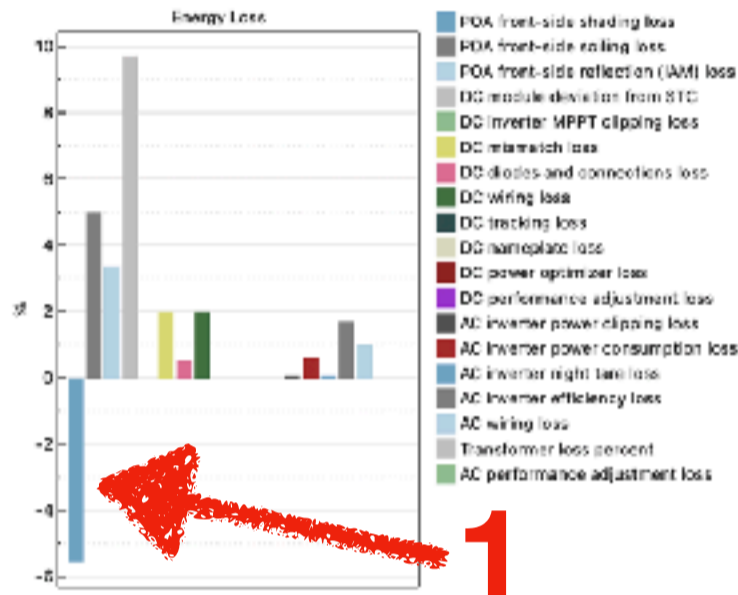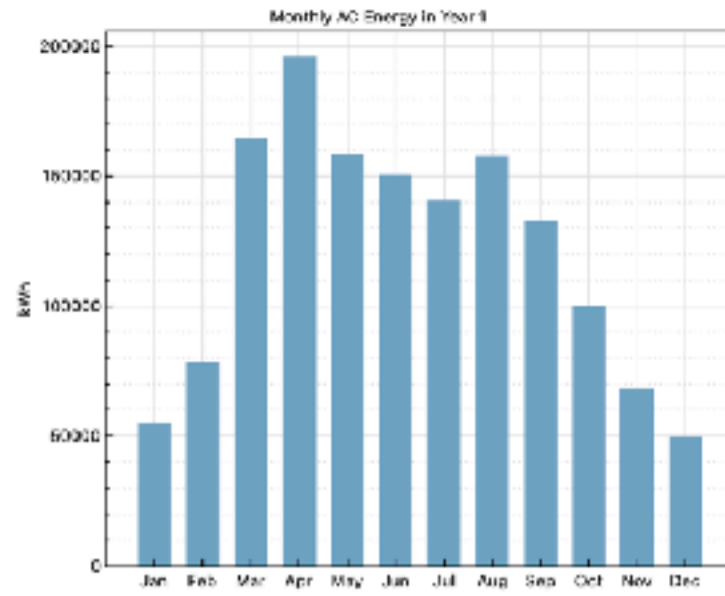

1

Hourly Data

System power generated (kW)

Jan 1, 12:00 am	-0.123624
Jan 1, 01:00 am	-0.123624
Jan 1, 02:00 am	-0.123624
Jan 1, 03:00 am	-0.123624
Jan 1, 04:00 am	-0.123624
Jan 1, 05:00 am	-0.123624
Jan 1, 06:00 am	-0.123624
Jan 1, 07:00 am	-0.123624
Jan 1, 08:00 am	-0.123624
Jan 1, 09:00 am	82.3016
Jan 1, 10:00 am	218.55
Jan 1, 11:00 am	54.0492
Jan 1, 12:00 pm	67.9989
Jan 1, 01:00 pm	79.8417
Jan 1, 02:00 pm	47.921
Jan 1, 03:00 pm	-0.123624
Jan 1, 04:00 pm	-0.123624
Jan 1, 05:00 pm	-0.123624
Jan 1, 06:00 pm	-0.123624
Jan 1, 07:00 pm	-0.123624
Jan 1, 08:00 pm	-0.123624
Jan 1, 09:00 pm	-0.123624

	A
1	1188
2	1188
3	1188
4	1188
5	1188
6	1188
7	1188
8	1188
9	1188
10	1188
11	1188
12	1188
13	1184,5
14	1183,46
15	1182,03
16	1181,39
17	1177,84
18	1173,67
19	1166,86
20	1166,1
21	1157,37
22	1155,38
23	1150,9
24	1145,56
25	1144,61
26	1137,36

2

3

